

Smart UG Cable Fault Detector

D. Sharmitha, J.J.Nandhini

Abstract: Nowadays underground cables are used over than overhead lines in urban areas. Locating the fault in the underground (UG) cable is tedious and there is a probability of damaging the insulation while digging the cable. The proposed system offers easy and smart fault detection by automating it using a ARDUINO controller. The basic concept of Ohm's law is applied at the feeder end though a series resistor. In case of short circuit of LL or LLG or LG the current flowing in the faulty sections will vary depending on the length of the line. This paper aims at estimating the location of fault distance and intimating the personal through SMS (short message service). The data are send to a dedicated website together with on board LCD display by using a GSM module and Internet of Things (IoT).

Keywords: Electrical cable, Resistance, GSM, Wi-Fi modem, IoT (Internet of Things).

I. INTRODUCTION

One of the prime objective of 12th five year plan (2012- In Urban areas due to the unavailability of land and space underground transmission is preferred than overhead transmission system. The advantages of UG cable are 1. Copper loss is less 2. Increased Space utilization 3.Low voltage Drop 4. Less maintenance cost 5. Free from pollution, significant precipitation, snow and storm, etc. However, during fault location of the cable it's hard to trace out the precise location of the fault. Nowadays people are used to gadgets and other digitalization. Hence, a digital method is used to trace out the precise location of the fault. The data is interconnected with a website and on board LCD display, GSM module and Internet of Things (IoT). The main reasons of cable fault are: i) inconsistency ii) Damage iii) insulation failure and breaking of the conductor. Usually occurring faults are Short Circuit Fault, Open Circuit Fault, Earth Fault

As soon as the fault occurs, the repairing associated with that exact cable fault is incredibly tough. To overcome this drawback, the smart underground cable fault detector is used. In order to trace out the faults in the buried cable prior knowledge of location and direction of flow is required. Meanwhile it's very hard to search out a cable fault without knowing where the cable is. Before locating the fault to begin with, the direction of in which the cable is laid from the feeder end should be known. The realization of fault pursuit associated in locating the underground cable specially depends on the ability, statistics and knowledge of that person. [1] described a method to trace out the cable fault distance from the base station using Arduino board. The classic concept of the Ohms law was employed.

[2] presented a system which includes of current sensors, microcontroller and Wi-Fi modem. This acts as a path to real serially communicate the real time data towards the server.

Finally it is interconnected with the help of Internet of Things (IoT). From the server these real time data can be retrieved from laptops or smartphones. It is explained in [3], an algorithm to forecast the cable fault location between two adjacent manholes. On account of incipient faults this algorithm works in time-domain, which uses the data collected from power quality monitors. The fault location is estimated in terms of line impedance considering the arc voltage associated with the faults. In [4] proposed a system in which the fault creation is made by a set of switches at every known distance in km. The fault distance is displayed in LCD interfaced with the microcontroller. The behavior of simultaneous fault signals in distribution side UG cable using Discrete Wavelet Transform is proposed in [5].

The proposed system relies on finding the exact distance of UG cable fault from the base station (km). This project uses Ohms Law. A low voltage DC is applied to the feeder end through cable lines. The voltage varies based on the location of fault occurred in the cable. The variation of voltage depends on the resistance value of that cable. The signal is fed to the Arduino Microcontroller that is pre-programmed and also the fault distance is send to the individual through SMS. Also, the data is sent to dedicated web site by employing a GSM module, IoT.

II. EXISTING METHOD

In this section, some of the methods adopted earlier for cable fault detection is explained.

A. Online Method:

In this technique, the sampled current and voltages are utilized to figure out the faulty points.

B. Offline Method:

Here a special instrument is used to figure out service of cable among the sphere. Offline techniques are:

1. Tracer technique
2. Terminal technique.

C. Tracer Method:

The fault of the cable is detected by walking on the cable in this technique. Magnetism or perceptible signal is applied on the cable to identify the fault. This system helps in location of fault accurately.

D. Terminal Method:

This system is utilized to chase general areas of the fault on buried cable. The above methods gives solution for dealing with the problems only to alert the personnel.

Thanks to IoT for mitigating the problem. Through this, everything becomes interconnected and smart.

Revised Manuscript Received on December 08, 2018.

D. Sharmitha, Department of Electrical Engineering, Kumaraguru College of Technology, Coimbatore, TamilNadu, India

J.J.Nandhini, Department of Electrical Engineering, Kumaraguru College of Technology, Coimbatore, Tamil Nadu, India

From the knowledge of previous researches we made a conclusion that when we are talking about underground fault it really becomes a tough job. Hence, in the proposed system fault switches are employed along with the underground cable. The sensed fault location is serially communicated towards the server with the help of GSM module from where information can be retrieved through IoT.

III. PROPOSED SYSTEM

The fig. 1, fig. 2 shows the working of the proposed system. In the proposed system fault switches are employed along with the underground cable. Whenever we press the switch, fault is created, and the arduino which is already pre-programmed senses the voltage changes and the fault distance is calculated. Arduino coding is done by using embedded C language and Arduino software. The LCD which is interfaced with the Arduino displays the fault occurring region and the fault distance is sent to the respective person through mobile. Also, these data is sent to a dedicated website by using a GSM module and IoT. A webpage is created by using Freeboard.io open source software. The fault is indicated to the personal by an alarming signal using a buzzer system.

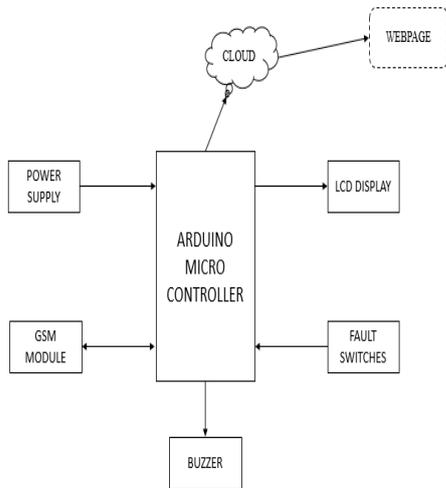


Fig-1. Block Diagram

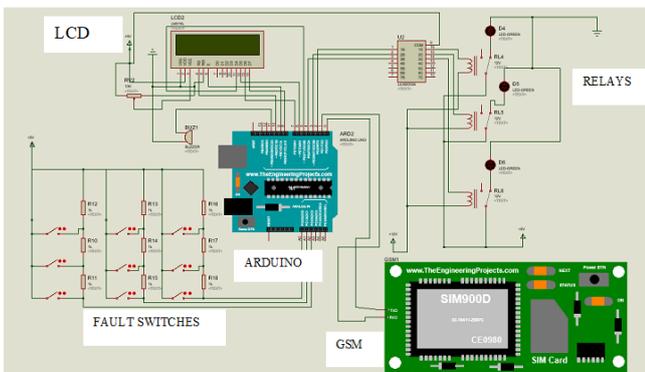


Fig-2. Circuit Diagram of Proposed Method

IV. ALGORITHM

The step by step procedure of Smart UG cable fault detector is shown in Fig 3.3. The input and output ports are initialized in the Arduino microcontroller and GSM is

configured. The algorithm will check for faults in underground cable. If any fault encountered the controller will send intimation. The results are viewed in a LCD display. The fault distance is sent to the respective person through mobile. Also, the fault distance will be displayed in the web page.

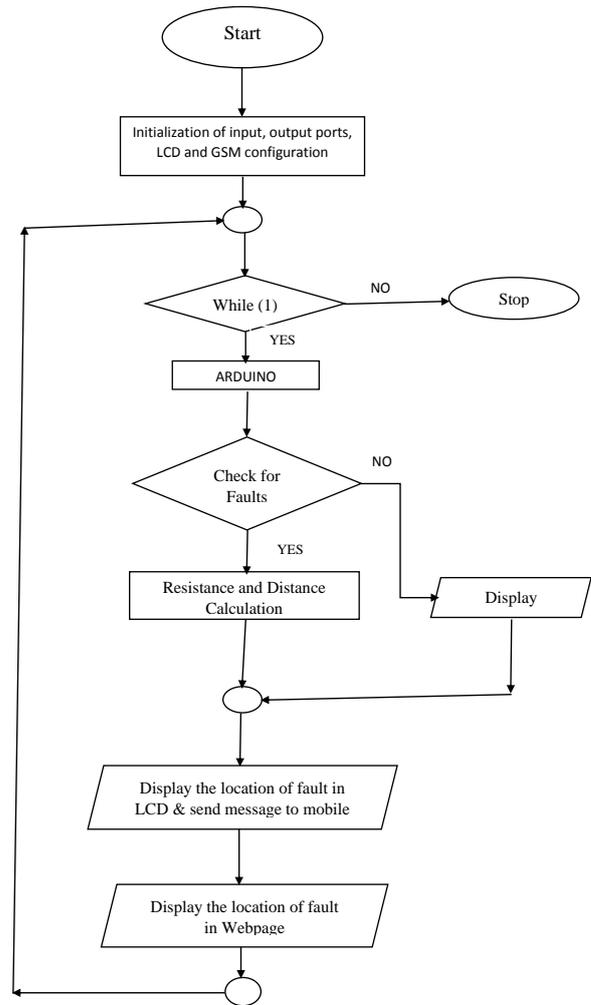


Fig-3. Work Flow Chart

CALCULATION OF UG CABLE RESISTANCE:

The ac cable resistance can be calculated by using the following equation 1.

$$R_{ac} = R_{dc} (1 + Y_s + Y_p) \rightarrow \text{eqn.1}$$

The dc cable resistance can be calculated by using the following equation 2.

$$R_{dc} = \left((1.02 * 10^6 * \rho (1 + \alpha(\theta - 20))) \right) / \rightarrow \text{eqn.2}$$

V. SIMULATION DIAGRAM

The proposed system of Smart UG cable fault detector is implemented using PROTEUS version 8 software. The arduino tool is used for coding the simulation. Fig 4 shows the simulation diagram for three phase Underground cable. The Simulations results are justified with the hardware results which are described in the following sections. Fig 5 shows the Hardware model of Smart UG cable Fault Detector.



The rating of the transformer used is 230/12V. A voltage regulator converts the 12V supply to 5V to supply the Arduino and fault switches. The 12V is given to the relay coil. The SIM-900 GSM Module is used to give network to the arduino and also for sending the SMS. Another transformer is used for supplying 9V to the GSM module. With these components, the hardware of the Smart UG cable Fault Detector is implemented and the obtained results are compared with the simulation results which are discussed as follows.



Fig-6(B) Hardware Results For Single Phase Underground. Cable Without Fault

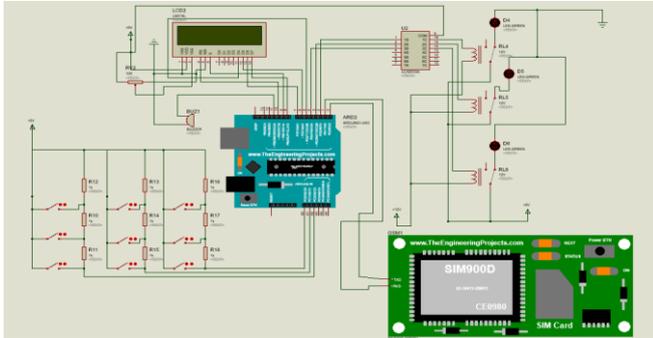


Fig-4. Simulation Diagram

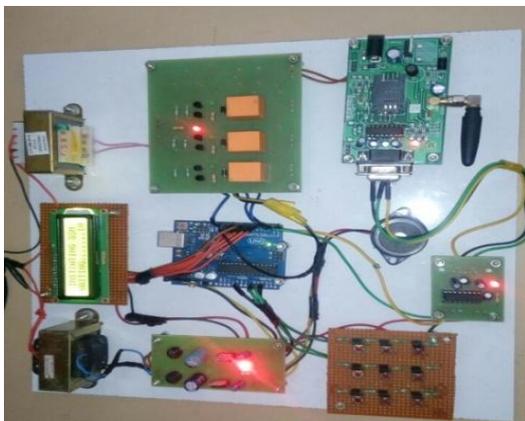


Fig- 5. Prototype Model

VI. CASE STUDY

CASE I: OPERATION UNDER IDEAL CONDITION

Fig 6. (a) shows the simulation output of Single phase underground cable under ideal condition. It can be seen from the Fig 4.3 a) that the LCD is displaying No Fault in the Cable.

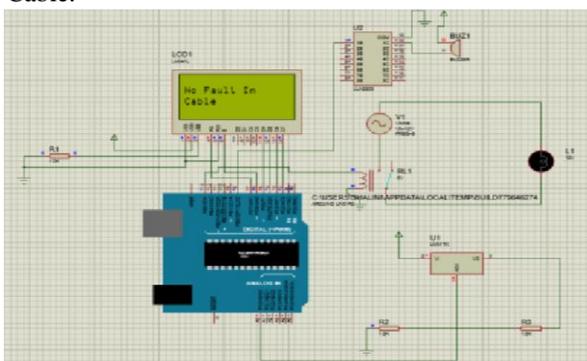


Fig-6(A) Simulation Results For Single Phase Underground Cable Without Fault.

CASE II: OPERATION UNDER FAULT CONDITION

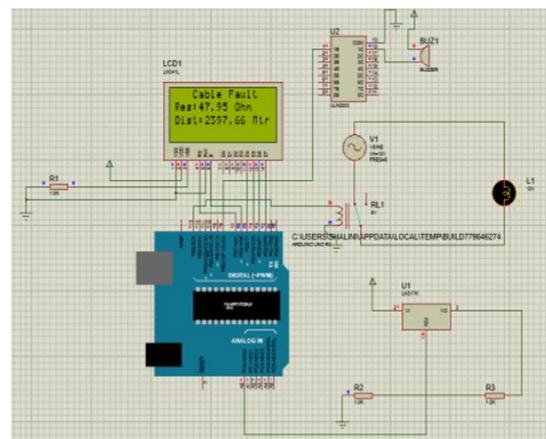


Fig 6.(C). Simulation Results Of Single Phase Underground Cable Under Fault.

It can be seen from the Fig 6. (b) the LCD displays INITIATING GSM WAITING under ideal condition. Since no faults are initiated. Fig 6. (c) shows the simulation output for Single phase underground cable with fault. The controller senses the change in resistance and changes the ADC value.

The ADC output is measured as a distance in meter as shown. Then, the relay is opened and the buzzer gives an alarm.

In the hardware setup, for fault identification at every 1 Km length of the cable 1 KΩ resistor is used. Table I shows the values of voltage, distance, resistance and ADC output of the controller under different fault conditions. For instance, if we look from the leftmost switch, the third switch is pressed, it will create short circuit fault and exclude the 3KΩ resistances from the circuit so the fault distance is 3km from the feeder end as shown in Fig 6. (d).



Fig 6.(D). Hardware Results Of Three Phase Underground Cable Under Fault.

S. No.	Switch closed	Voltage across series resistor (V)	Distance at which Fault occurred (Km)	Resistance of the cable (KΩ)	ADC Output
1	SW1	3.30	1 Km of first cable	3	180
2	SW5	4.00	2 Km of second cable	2	204
3	SW9	4.40	3 Km of third cable	1	230

Table 1. Table of Results

Fig 6. (e) that the proposed system the exact location of the fault distance in Km is sent to the individual through SMS via GSM module.

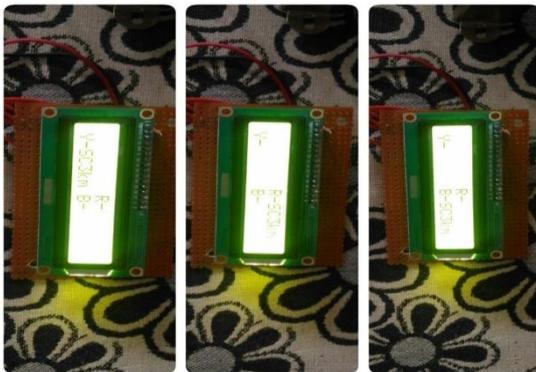


Fig 6.(e). Message Notification.

The same information with cable resistance is also sent to a dedicated website and the respective person can retrieve the data from the server at any time. The output when the second switch is pressed is shown in Fig 6. (f).

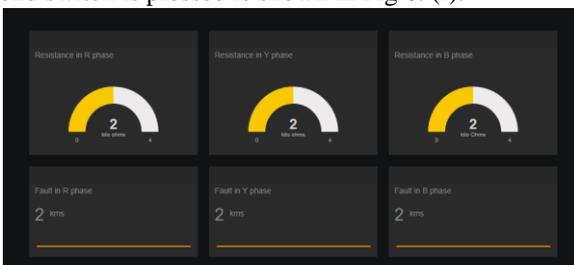


Fig 6.(f). Output retrieved from the Webpage.

VII. CONCLUSION

Detecting the exact location of the fault in underground cables is a difficult task. The exact location of the open circuit fault and short circuit faults are identified from the proposed system.

The data is sent to a dedicated website and alert the respective person through SMS by using a GSM module and IoT. On account of fault in the cable, the Buzzer alarm is used to alert the person if he is not using the mobile. The following are the merits of the proposed system:

- Less Maintenance
- This method is applicable to all types of cables
- It can detect all types of faults
- Cost-effective
- Less complexity
- More safety

This prototype can be able to sense the exact location of different faults like earth, short and open circuit fault in UG cables from the feeder end. In future, this project may be intended to detect even minute faults occurring in any region. This work can also be extended to detect faults by calculating impedance at each phase.

REFERENCES

1. Aqib Al Husan Ansari, AtulBarhate, 'Arduino based Underground Cable Fault Detection', International Journal for Research in Engineering Application & Management (IJREAM) ISSN: 2454-9150 Vol-03, Issue 04, May 2017.
2. Abhas, AbhinavShukla and RiwiKomal(2016)'IoT based Underground cable fault detection and monitoring', IJCTA, 9(22), 2016, pp. 145-150.
3. Pooja P.S and Lekshmi M(2015) Fault Detection Technique to pinpoint Incipient Fault for Underground Cables'-International Journal of Engineering Research and General Science Volume 3, Issue 3, May-June, 2015.
4. DhivyaDharani. A, Sowmya. T 'Development of a Prototype Underground Cable Fault Detector', 2347-2820, Volume -2, Issue-7, 2014.
5. A.Ngaopitakkul, C.Pothisarn, M.Leelajindakrairerk, 'Study of Characteristics for Simultaneous Faults in Distribution Underground Cable using DWT', 2011 IEEE.
6. G.H.Shirkooi,K.Hasan,'Enhanced TDR technique for fault detection in electrical wires and cables' ,103 Borough Road London SE10AA1,united kingdom,2nd International symposium NDT in aerospace (2010).
7. AbhishekPandey and Nicolas H. Younan(2010) 'Underground cable fault detection and identification via Fourier analysis' International Conference on High Voltage Engineering and Application, 11-14 Oct. 2010.
8. H. Shateri, S. Jamali, 'Impedance Based Fault Location Method For Phase To Phase And Three Phase Faults In Transmission Systems', IEEE 2010.
9. .AbhishekPandey, Nicolas H. Younan, 'Underground Cable Fault Detection and Identification via Fourier Analysis', 2010 IEEE.
10. Yuan Liao, Ning Kang, 'Fault-Location Algorithms Without Utilizing Line Parameters Based on the Distributed Parameter Line Model', IEEE.
11. S. Navaneethan, J. J. Soraghan, W. H. Siew, F. McPherson, P. F. Gale ,'Automatic Fault Location for Underground Low Voltage Distribution Networks' IEEE Transactions on Power Delivery, Vol. 16, no. 2, April 2001.

