

Synthesis and Application of CeO₂ and ZrO₂ Nanoparticles for Enhancement of Dielectric Strength of Transformer Oil

G Suri Babu, Tirumalasetty Chiranjeevi

Abstract: Power and Distribution transformers are the key devices to maintain power system reliability. Thus in-order to have continuous power supply, a fault tolerant system is to be developed by avoiding the failures on major devices like transformers. As insulation failure is accounted as 13.0% occurrence of all the faults on transformer, there is always a point of interest to enhance the breakdown strength of the transformer oil. Also to cater to the demand, an increase in the number and unit capacity of high voltage transformers require transformer oil with high oxidation stability and good electric properties. In this work, ceramic nanomaterials zirconia(ZrO₂) and Ceria (CeO₂) are preferred due to their strong insulating property and high relative permittivity. The synthesized nanomaterials of concentration (0.5%wt) are dispersed into the transformer oil by sonication and AC breakdown measurements have been performed on the prepared nano transformer oil. The obtained results clearly indicates a remarkable increase in the dielectric strength of transformer oil filled with ZrO₂ and CeO₂nanoparticle.

Index Terms: Transformer oil; Breakdown strength; Combustion synthesis; Nanoparticles.

I. INTRODUCTION

Reliable power supply without interruption is very essential in the fast growing global energy market. Power and distribution transformers are the major devices in the interconnected power system where their operation is directly related to the power system reliability. Therefore it is always needed to protect the transformers from the major faults listed in the Table I.[1].

Table I:Major Faults on Transformers

S.No	Type of faults	% of occurrence
1	Lightning Surges	12.4
2	Line Surges/External Short Circuits	21.5
3	Deterioration of Insulation	13.0
4	Overloading	2.4
5	Moisture	6.3
6	Inadequate Maintenance	11.3
7	Loose Connections	6.0
8	All others	27.1

Revised Manuscript Received on July 05, 2019

G. Suri babu, Electrical & Electronics Engineering Department, Vishnu Institute of Technology, Bhimavaram, Andhra Pradesh, India.

Tirumalasetty Chiranjeevi, Electrical Engineering Department, Rajkiya Engineering College Sonbhadra, Uttar Pradesh, India.

From the above table it was clear that the insulation failure is considered as the third major fault in terms of occurrence on the transformers. So, efforts has to be made to reduce the insulation failures, which indirectly improves the reliability of the interconnected power system. Mineral oil as transformer oil fulfills important functions in the insulating system such as di-electric, heat transfer agent(coolant) and arc quencher. The reliable performance of the transformer oil depends upon the basic oil characteristics, its oxidation stability, stability in an electric field and its compatibility with other insulating materials in the system. Therefore to ensure long and uninterrupted life time service of transformer, it is pertinent to increase the mineral oil properties like di-electric strength [6]. In recent years, use of nanomaterials for improving the liquid di-electrics is became a thrust area of research [3]. So much of literature is already available in this area and in this paper we demonstrated the effect of dispersing zirconia(ZrO₂) and Ceria (CeO₂) nanoparticles in transformer oil [5]. Also if the dielectric electric strength of transformer oil is improved its loading capacity will also increases[2].

II. MATERIALS AND SYNTHESIS PROCEDURE

In this work, ceramic nanomaterials like zirconia(ZrO₂) and Ceria (CeO₂) are chosen because of their high relative permittivity and good electrical insulating properties. Zirconia and ceria nanoparticles are synthesized by combustion synthesis technique (CS).Combustion method is an easy and convenient method for synthesizing advanced ceramic nano materials. In this technique the desired product is synthesized by self-sustained exothermic chemical reactions at a higher rate due to its own heat release, without taking much energy from furnace. The solution is prepared by reacting zirconium nitrate and cerium nitrate with glycine and distilled water using a magnetic stirrer. The prepared solution is heated up to 150°C for 20 minutes to form clusters. The clusters are calcined using a muffle furnace and finally synthesized nanoparticles are dispersed in to transformer oil using an ultra sonicator. The entire process is shown in the figures 1 and 2.



Fig.1.Synthesis of Nanoparticles using combustion synthesis.

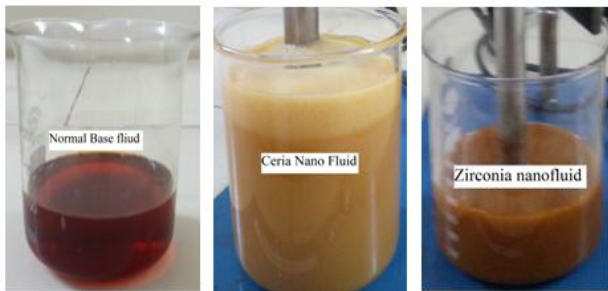


Fig.2. Transformer oil with 05% wt .Ceria and Zirconia of Nanoparticles .

III. CHARACTERIZATION

A. XRD analysis

The X-ray diffraction patterns (XRD) of prepared CeO₂ and ZrO₂nanomaterials were obtained using a diffractometer with Cu target , voltage:40K, current:30 mA producing K_α radiation of wave length $\lambda = 1.5418 \text{ \AA}$. The XRD of prepared samples are shown in the Figures 3 and 4.

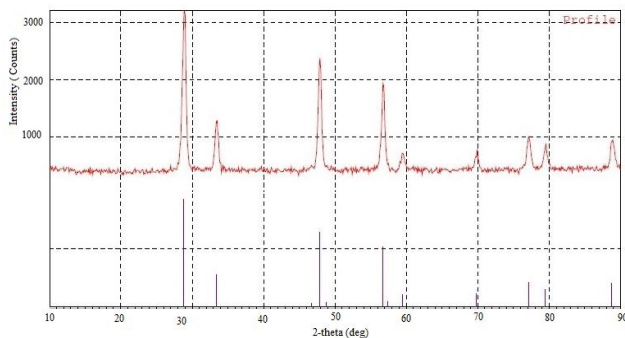


Fig3.CeO₂ XRD Pattern .

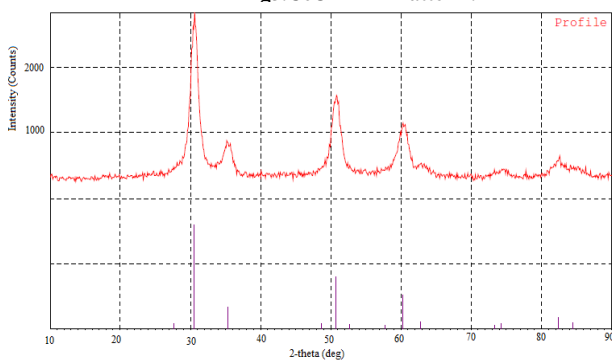


Fig4.ZrO₂ XRD Pattern

The XRD pattern of CeO₂and ZrO₂sample resembles with JCPDS file no 75-0076 and JCPDS file no17-0923, also the crystalline size prepared samples is determined using Scherrer formula : $D = \frac{0.94 \lambda}{B \cos \theta}$, where D is the crystalline size in nanometers, B is full width half maxima of maximum intensity peak and θ is the angle corresponding to peak. The size of the CeO₂ and ZrO₂ samples are estimated as 9.114nm and 5.4nm respectively.

B. SEM analysis

To obtain the surface morphology of prepared samples, SEM images of CeO₂andZrO₂nanomaterialswas taken at an

operating voltage of 20KV at 25000x magnification are shown in the figures 5 and 6. Porous structure is observed in Ceria and flakes structure is seen in zirconium.

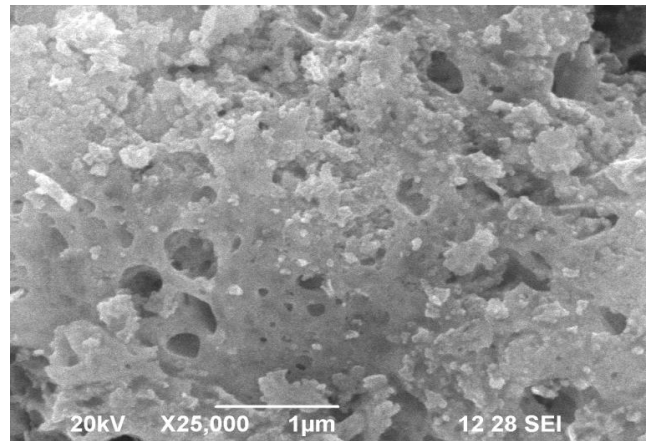


Fig.5.Surface morphology of CeO₂ nanomaterials .

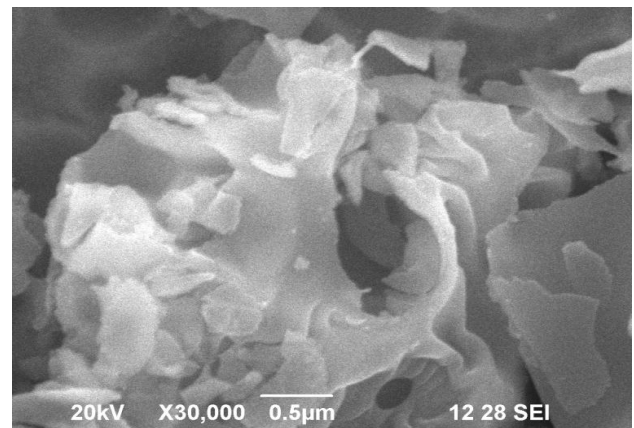


Fig.6.Surface morphology of ZrO₂ nanomaterials .

IV. EXPERIMENTAL SET UP

A. AC Breakdown Voltage

Dielectric strength of transformer oil is also termed as break down voltage (BDV) where the oil loses its insulating property when subjected to high electrical stress between two electrodes. Minimum breakdown voltage is termed as the point where the transformer oil can be used safely and in general the standard value is considered as 30 KV [4]. A standard BDV measuring instrument shown in the figure 7 which consists of oil beaker in which oil to be tested is filled with 2.5mm gap is used for breakdown voltage measurements. The oil between the electrodes is subjected to electrical stress by applying high voltage at a rate of 2KV/s across the electrodes.

AUTHORS PROFILE



Fig.7.Standard BDV measurement Kit.

0.5% of weight of ceria and zirconia nanoparticles are dispersed in to the transformer oil and dielectric strength of transformer oil filled with ceria and zirconium nanoparticles is experimentally determined using BDV kit in the laboratory .The results are tabulated in the Table II.

Table II: Results of AC Break down Voltage

Samples	Breakdown Voltage (kV)	% Increment
Pure	36.0	-
0.5% wt. CeO ₂	50.0	38.88
0.5% wt. ZrO ₂	42.0	16.66

V. CONCLUSIONS

In this work, CeO₂ and ZrO₂ based nano transformer oil is prepared using solution combustion synthesis procedure. The breakdown strength of transformer oil filled with 0.5% wt. of CeO₂ and ZrO₂ is measured using standard BDV instrument. Experimental results clearly shows a significant increment in the dielectric strength of transformer oil , 38.88 % for CeO₂ and 16.66% for ZrO₂ nano fillers. Further with this insulating oil, transformer loading capacity will be improved which ultimately increases transformer life time.

REFERENCES

1. Transformers, BHEL, Bhopal, Tata Mcgraw-Hill Publishing Company Limited, Seventh Reprint, 1995.
2. R. Karthik, R. Madavan, "A study on enhancement of critical parameters of transformer oil using nanomaterials", IEEE International Conference on Nanoelectronics ICONS 24 February 2011, pp. 66-69.
3. T. Tanaka, "Dielectric nanocomposites", IEEE Transactions on Dielectrics and Electrical Insulation, Vol. 12, pp. 914-928, 2005.
4. A. Segal, A. Hjortsberg, A. Rabinovich, D. Natrass, K. Raj, "AC (60HZ) and impulse breakdown strength of a colloidal fluid based on transformer oil and magnetic nanoparticles", IEEE International Symposium on Electrical Insulation, 1998, pp. 619-622.
5. D. Yuefan, L. Yuzhen, L. Chengrong, C. Mutian, Z. Jianquan, et al., "Insulating property and mechanism of semiconducting nanoparticles modified transformer oils", Proceedings of the CSEE, Vol. 32, pp. 177-182, 2012.
6. J. Hajek, M. Dahlund, L. Petterson, "Quality of oil makes the difference ABB discovers the solution to transformer breakdowns", ABB Reviews, Vol. 3, pp. 61-63, 2004.



Mr. G. Suri babu is currently working as Associate Professor in the department of Electrical and Electronics Engineering at Vishnu Institute of Technology, Bhimavaram A.P. His main research area is Super capacitors and it's applications.



Mr. Tirumalasetty Chiranjeevi is currently working as Assistant Professor in the department of Electrical Engineering at Rajkiya Engineering College Sonbhadra, Uttar Pradesh, India. His main research area includes fractional optimal control.