

Three-Phase Power Analyzer using Labview

Muhammad Sulaiman Khan, Saleem Abbas, Nadeem Afridi



Abstract: An important requirement of power systems in this decade is the capability of power distribution among electrical devices and systems to improve power quality that depends on various factors, such as reactive, active, and apparent power. Virtual experiments and testing are considered important factors to achieve the best performance in this area. This research mainly aims to find low power factors and load to meet the requirements of electrical devices. Calculations are conducted on a real-time simulator LabVIEW to verify the effectiveness of linear and nonlinear values on the load to achieve the power factor.

Key words: LabVIEW, power quality, load, low power factor

The correct values of signal, voltage quality, and power factor are difficult to obtain because the distortion in parameters results in various errors. For high quality power equipment, Low power factor should be maintained to increase the versatility of the power system for achieving high power quality of equipment. In this paper, a scheme based on virtual equipment is proposed, Personal computers (PCs) and acquisition cards are used to convert signals, and programs are used to control and record the results and outputs on the basis of hardware data.

I. INTRODUCTION

In this modern era, the power distribution in electrical devices is extremely important for industrial equipment and electrical devices. Accurate calculation of power factor is vital for devices. With the advancement of technology, virtual experiments and testing are extremely important for researchers [1]. The distribution models for small and multiple sources are becoming noisy and dynamic, thereby increasing the cost and decreasing the power efficiency, accuracy, and measurements [2,3]. The literature demonstrates that LabVIEW is used in controlling and monitoring the variables in various electrical and industrial applications [4-9]. The power quality of electrical signals must be good to transfer from the load function with proper waveforms, magnitudes, and distortions. Therefore, power quality is an extremely important aspect of distribution systems that enables all equipment to operate in healthy condition [10-13]. Equipment malfunctioning will occur when these conditions are unsatisfied. Thus, data losses and machine problems occur at steady level voltage in limited range. Therefore, good power quality should be maintained in electrical flow to measure the power quality, possible effects, and risks in electrical installations. Harmonics, voltage dips, voltage current and current, electrical noise, flickers, and impulses are the commonly detected disturbances.

II. QUALITY PARAMETERS

The control of power quality parameters, such as frequency, waveform, and voltage, is extremely important. Contribution parameters, such as 3-voltage root-mean-square (RMS), three-current RMS, three-voltage and current waveforms, and three-frequency, are used in this study. With the help of virtual instruments, power is analyzed through manipulation and software development. Four steps are performed as follows: (I) Acquisition, analysis, and display of signals. (II) Sensors are used to measure the three-phase current and voltage. (III) A data acquisition (DAQ) card is used to interface the analog AC signal to the computer. (IV) The proposed virtual power analyzer is used to analyze the acquired signal and provide the desired output.

III. SIGNAL CONDITIONING

The signals from the transducer or sensor are suitable in data acquisition through two stages, namely, sensing and conditioning stages. In the sensing stage, the quantity of signals is measure with the help of special purpose sensors and transducers called current or voltage transducers. In the conditioning stage, the quantity of signals is sensed, and collected using an NI USB-6008. Data Acquisition: The data are conditioned and delivered from the DAQ card to the PC by converting the analog signal into a digital signal using an analog-to-digital converter. LabVIEW Interfacing: The DAQ card is attached to the PC to transmit and display the acquired signals on LabVIEW using the NI USB-6008. Signal Manipulation: The signal acquired by NI USB-6008 will be controlled on the basis of the requirements to achieve the desired values using many graphical equations. Figures 1 and 2 show the functional diagrams.

Revised Manuscript Received on January 30, 2020.

* Correspondence Author

Muhammad Sulaiman Khan*, Scholars Department, of Computer Science and Information Technology, Hefei University of Technology, Hefei, P. R. China.

Nadeem Afridi, Scholars Department of Computer Science and Information Technology, Hefei University of Technology, Hefei, P. R. China.

Saleem Abbas, Research Scholar, School of Electrical Engineering and Automation, Hefei University of Technology, Hefei, P. R. China.

© The Authors. Published by Blue Eyes Intelligence Engineering and Sciences Publication (BEIESP). This is an [open access](https://creativecommons.org/licenses/by-nc-nd/4.0/) article under the CC-BY-NC-ND license [http://creativecommons.org/licenses/by-nc-nd/4.0/](https://creativecommons.org/licenses/by-nc-nd/4.0/)

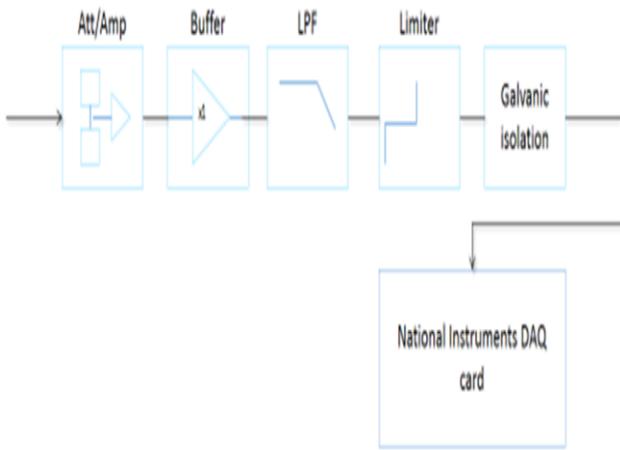


Fig. 1. Potential divider block diagram

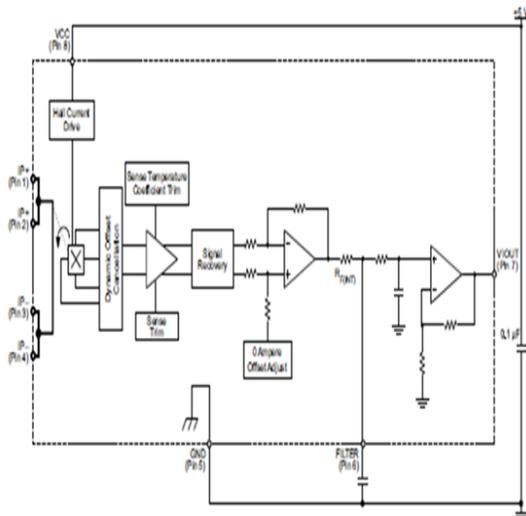


Fig. 2. Functional diagram

IV. SIGNAL CONDITIONING CIRCUIT

The potentiometer is set to 1 k for offset compensation. The signal conditioning circuit for voltage is simulated at the AC input of 220 V (RMS). The value of voltage transducer output is given to the signal conditioning circuit. The magnitude of the AC voltage source is 0.6 Vrms, and 0.85 V peak of potential divider output as the transducer gain is 0.2.

V. SIMULATION CIRCUIT SIGNAL CONDITIONING

The desired output of real-time voltage is 0.85 V, which is obtained in the processing of conditioning circuits using the NI USB-6008 at the peak-to-peak voltage of 13 V with positive and negative voltage of 6.6 V. This value is the per peak step-up voltage using an operational amplifier or dual amplifier to amplify the peak-to-peak voltage to 13 V on the basis of the DAQ requirements, where 0.2 is the gain value of potential divider output, as shown in Figures 2 and 3.

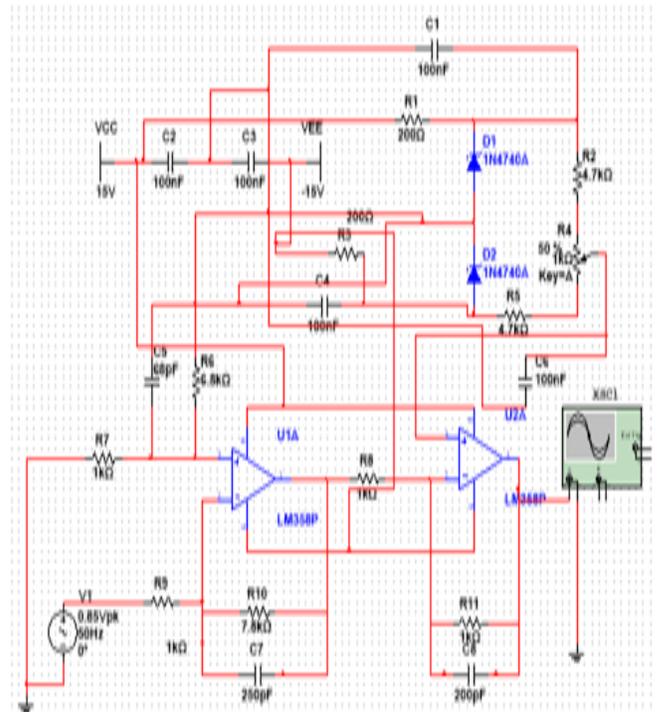


Fig. 3. Pure potential divider circuit on NI Ultiboard







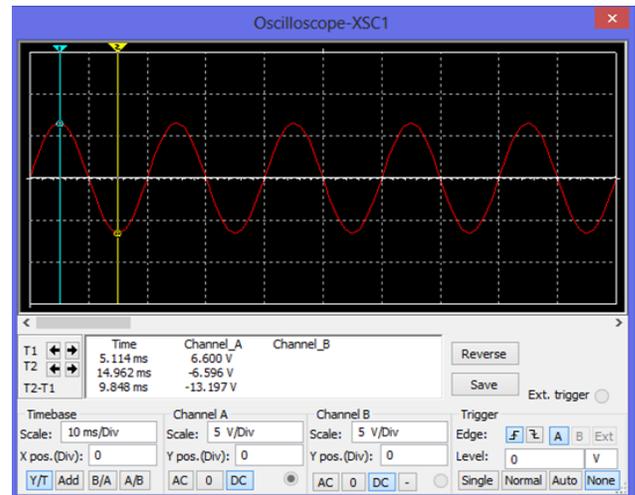


Fig. 4. Required output of potential divider circuit

VI. SIMULATIONS RESULTS

The desired output of real-time voltage is 0.85 V, which is obtained through the processing of conditioning circuits using the NI USB-6008 at peak-to-peak voltage of 13 V with positive and negative voltage of 6.6 V. This value is the per peak step-up voltage using an operational amplifier or dual amplifier to amplify the peak-to-peak voltage to 13 V on the basis of the DAQ requirements, where 0.2 is the gain value of potential divider output. The simulation results are provided as follows.

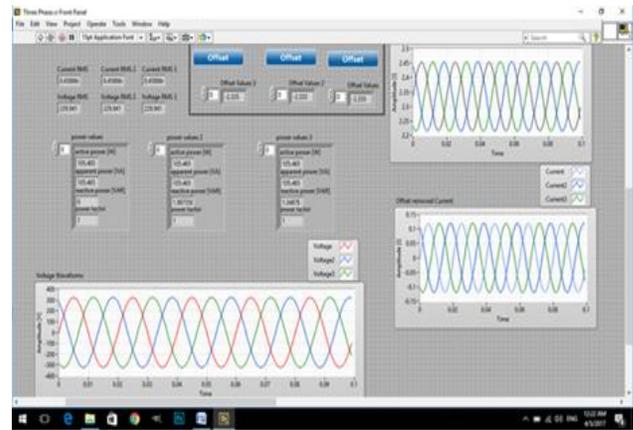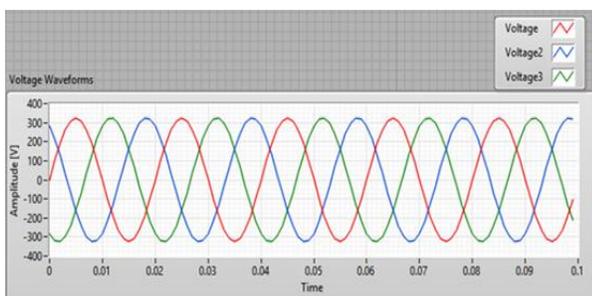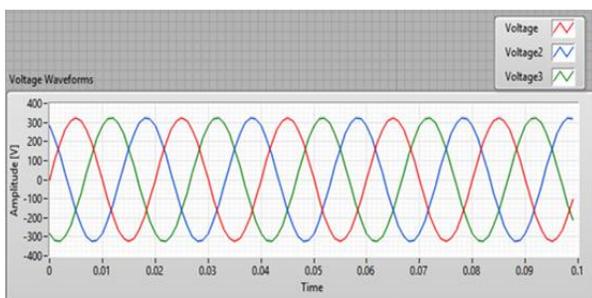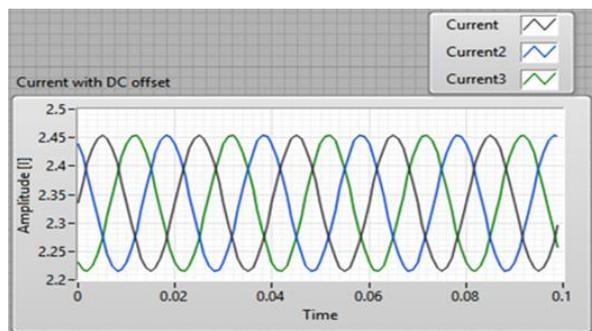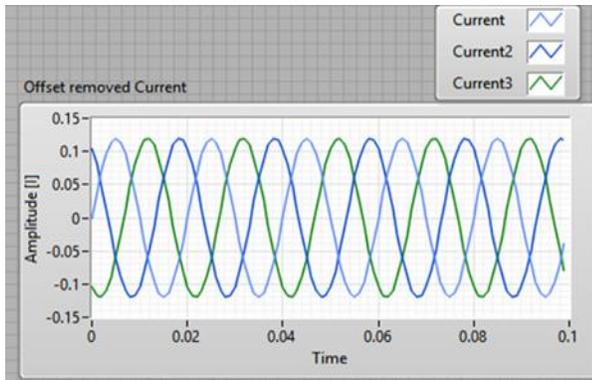

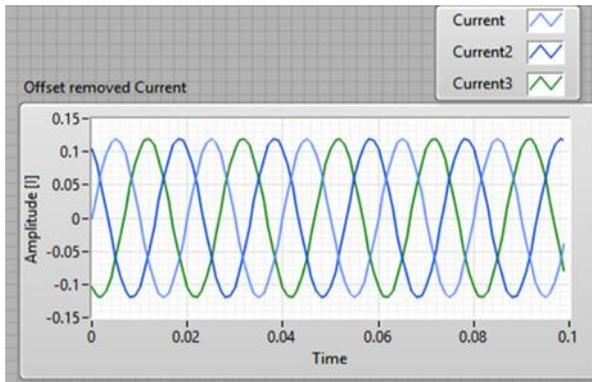

VII. CONCLUSION

In this study, a three-phase power quality analyzer prototype based on NI LabVIEW simulator is presented to analyze the power factor quality on the basis of linear and nonlinear functions and the disturbances in power quality runtime environment. The disturbances are removed using the proposed analyzer.

ACKNOWLEDGEMENT:

All the authors work equally in this manuscript

CONFLICT ON INTEREST:

The authors have no conflict of interest regarding this publication

REFERENCES

1. A. Singhal, A. Garg, S. S. Murthy and V. Sandeep, "Online parameter determination and performance analysis of three phase induction motor using virtual instrumentation," 2012 IEEE International Conference on Power Electronics, Drives and Energy Systems (PEDES), Bengaluru, 2012, pp. 1-6. doi: 10.1109/PEDES.2012.6484485
2. R. Timmons and T. Barczyk, "Asynchronous 3-phase power measurements," 2016 Conference on Precision Electromagnetic Measurements (CPEM 2016), Ottawa, ON, 2016, pp. 1-2. doi: 10.1109/CPEM.2016.7540740
3. V. N. Sujeer and R. Vaidyanathan, "Transient-recovery voltage characteristics of a 3-phase power system," in Proceedings of the Institution of Electrical Engineers, vol. 118, no. 1, pp. 119-124, January 1971. doi: 10.1049/piee.1971.0017
4. M. S. Murugan, L. Srikanth and V. P. S. Naidu, "Design and development of LabVIEW based environmental test chamber controller," 2017 International Conference on Electrical, Electronics, Communication, Computer, and Optimization Techniques (ICECCOT), Mysuru, 2017, pp. 1-4. doi: 10.1109/ICECCOT.2017.8284638
5. Jianwei Lia et al., Design of Humidity Monitoring System Based on Virtual Instrument, [online] Available: 10.1016/j.proeng.2011.11.2732.
6. Guo Shaofeng et al., A Temperature and Humidity Monitoring System Based on LabVIEW, [online] Available: 10.1109/ICDMA.2013.21.
7. Janani Rajaraman et al., A Labview Based Monitoring and Controlling of Various Process Variables, [online] Available: 10.15662/ijaree

Three-Phase Power Analyzer using Labview

8. Moumita Sahoo, "An approach to lab View based temperature & Relative Humidity Monitoring system", ACEEE Int.J.on control system and instrumentation, vol. 03, no. 02, March 2012.
9. M. Odema, I. Adly and H. A. Ghali, "LabVIEW-Based Interactive Remote Experimentation Implementation using NI myRIO," 2019 International Conference on Innovative Trends in Computer Engineering (ITCE), Aswan, Egypt, 2019, pp. 214-218. doi: 10.1109/ITCE.2019.8646602
10. Shah KH, Solangi AA, Siyal RA., "Power Quality Analysis of Solar Photovoltaic fed cascaded H-bridge five level inverter "International Journal of Electrical Engineering & Emerging Technology, Vol. 02, No. 01, JUNE 2019, pp 17-22.
11. Solangi AA., Gul, M., Shaikh, R., Umer, F., Pathan, N.K. and Memon, Z.A., 2018. "Effects of Modulation Index on Harmonics of SP-PWM Inverter Supplying Universal Motor" International Journal of Advanced Computer Science and Applications, 9(7), pp.167-174.
12. Solangi AA, Sahito A, Soomro S, Khatri S, Memon M. "Harmonic Analysis of Universal Motor Supplied by Single Phase PWM Inverter-Fed Drive" Sindh University Research Journal-SURJ (Science Series). 2016 Dec 21;48(4).
13. Kalsoom Bhagat, Mohsin A. Mari, Solangi AA, M. Zubair Bhayo, M. Haroon Nadeem "Simulation and Experimental Analysis of an AC-DC Converter with D.C Load" International Journal of Computer Science and Information Security (IJCSIS), Vol. 15, No. 8, August 2017

AUTHORS PROFILE



Muhammad Sulaiman Khan, is currently pursuing his MS degree in computer science at the Department of Computer Science and Information Technology, Hefei University of Technology. His research interests include wireless sensor networks, Internet of Things, and mobile communications. He served as a lecturer for 6 years in the field of wireless sensor networks.

Saleem Abbas is a MS student at the School of Electrical Engineering and Automation, Hefei University of Technology, Hefei, P. R. China

Nadeem Afridi is a PhD scholar in Department of Computer Science and Information Technology, Hefei University of Technology, Hefei, P. R.